

Installation, Operating and Maintenance Manual



For Saphir Basic Models:

Saphir 1 / Saphir 2
Saphir 3 / Saphir 4
Saphir 7 / Saphir 10



Designed &
Manufactured in the
UK

+44 (0)1787 370187
info@darouv.co.uk
darouv.co.uk

Unit 9 Ballingdon Hill Ind. Est.
Sudbury Suffolk CO10 2DX

Systems designed and manufactured by Daro UV in the
UK, other requirements considered. Daro UV is a
company registered in England & Wales.
Registration Number: 06070435.

Table of Contents

03	General
04	Safety
05	Installation
10	Controls & Indicators
11	Servicing & Maintenance
12	Cleaning
13	Warranty
14	Spares
15	General Arrangement Drawings


GENERAL

Description

The units are designed for the ultraviolet disinfection of water between 5°C and 23°C and can be fitted anywhere in a water system provided the maximum pressure and peak flow requirements are less than the maximum ratings (see specifications). The slower the water flow, the more effective the unit will be. The unit must be protected from frost when not operating. For ease of maintenance, installing an isolation valve, a bypass and a drain valve with the unit is recommended. For single-pass applications, it is best to install the unit close to the point of use, removing the need to store large volumes of treated water. If a storage tank is used it must be closely covered and should be cleaned and sterilised when the UV unit is fitted.

Water Quality and Filtration

Ultraviolet light penetrates cloudy or coloured water much less than clear water, therefore, it is essential to ensure the water is clear prior UV treatment. A filter removing particles down to 5-10 micron in size will ensure the water is suitable. Filtration will also extend cleaning intervals. Dissolved organic matter and metallic salts, mainly iron, will also absorb UV light and reduce the unit's effectiveness. If parameters exceed the EEC maximum admissible concentrations, suitable pretreatment should be used to ensure water purity and effective UV treatment. Individual sites and requirements vary. Therefore, a site survey is recommended to determine the necessary ancillary equipment and filtration required before the UV equipment can be specified. If in doubt, please contact the manufacturer for advice.



To uphold peak performance, it is essential to schedule annual maintenance for this product. Kindly liaise with our sales team on either:
+44(0)1787 370187
or
info@darouv.co.uk

What is UV-C?

- UV is part of the electromagnetic spectrum, with a wavelength just outside the visible light.
- UV light with germicidal properties (UV-C) can be used for disinfection.
- The UVC lamp within the Saphir unit produces a wavelength of around 254nm (nanometres). At this wavelength when an organic cell is exposed to the UV-C light, it causes a photochemical reaction within the Nucleic acids (DNA & RNA) of the micro-organisms, rendering them unable to reproduce. This process is referred to as 'inactivation'.
- The UV-C disinfection leaves no residual chemicals in the water after processing.

SAFETY

Read the instructions fully before use – installation and maintenance should be carried out by qualified individuals.

Do not operate the unit if any part appears damaged.

The Saphir range is supplied with a standard, BS1363 UK mains plug and should be connected to an earthed 220-240V, 50-60Hz, single phase and neutral supply, via a 3A fused socket.

The control box is provided with a trailing earth lead – **this must be connected to the stud on the chamber body**. If the installation of the chamber has interrupted a water pipe, bond these together again.

UV-C radiation is harmful to eyes and skin, care should be taken when using UV-C.

The UV lamp must never be illuminated outside of the reaction chamber.

UV lamps contain various gasses and mercury. Care must be taken not to touch any of the glass (quartz) part of the lamp. It is recommended that gloves are used in case of lamp breakages.

If the lamp becomes damaged/broken ensure the area is well ventilated.

Professional help should be sought in the event of any mercury spillage.

The reaction chamber must be correctly earthed.

This unit must be installed by a qualified electrician.

Safe Disposal and Risk Due to Damaged Lamps

The lamps used in the Saphir Systems are filled with gas and mercury vapour at low pressure. Although they will not explode if broken there is a toxicity risk from mercury contaminated glass. In the unlikely event that mercury is released from a broken lamp, evacuate the area and ventilate it. Seek professional help to clean up the spilled mercury. Do not use a vacuum cleaner as this will heat the mercury causing it to vaporize and create a greater widespread hazard.



Optical radiation
emission
Category 2
(EN 12198)



Waring
Contains
mercury



Danger
electric
shock risk



Danger
hot
surface

INSTALLATION

Saphir Basic Content

Control Box
(Saphir Basic)



Chambers

Saphir 10



Saphir 4/7



Saphir 2/3



Saphir 1



INSTALLATION

Reactor Chamber Installation

Saphir Systems are all fitted with BSPT fittings.

STOCK CODE/ MODEL	SAPHIR 1	SAPHIR 2	SAPHIR 3	SAPHIR 4	SAPHIR 7	SAPHIR 10
Connection (BSPT male)	3/4"	3/4"	3/4"	1"	1"	1.5"

Recommended Chamber and Flow Arrangements



WARNING

UV Chamber should not be allowed to drain under operating conditions.




Control Box Installation

Suggested Control Box Locations

The electrical control box can either be mounted directly to the chamber using the mounting brackets or wall mounted within 625mm of the chamber.

The electrical control box is fitted with an internal 2 amp fuse and external UK type G plug.

Refer to unit specification for electrical requirements.

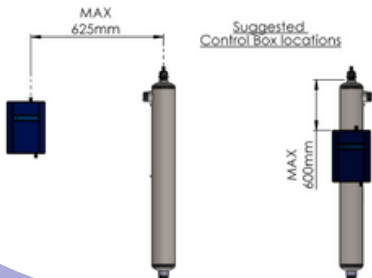

INSTALLATION


Chamber Mountings




A Chamber wall-mount bracket



B Worm-drive Clip
a: small
b: large



C Saphir 10 wall-mount brackets



D Quartz Clamp Key

MODEL	QUANTITY SUPPLIED	CONTROL BOX BRACKET	CONTROL BOX BRACKET	WORM CLIP SMALL	WORM CLIP LARGE	WALL BRACKET SAPHIR 10	QUARTZ CLAMP KEY
SAPHIR 1		2	2	3	0	0	1
SAPHIR 2		0	2	3	0	0	1
SAPHIR 3		0	2	3	0	0	1
SAPHIR 4		0	2	3	0	0	1
SAPHIR 7		0	2	3	0	0	1
SAPHIR 10		0	0	0	1	2	1

INSTALLATION

Chamber Mounting

The unit can be mounted horizontally or vertically, however, consideration should be given to the following:

Chamber

Before installing the unit, check the tightness of the quartz clamp. Using the key provided, ensure the clamp is tightened to 3.5 - 4.0Nm torque setting. (This is equivalent to a firm hand tight.)

Vertical Mounting

Water should enter at the bottom and exit at the top. Lamp access should be uppermost with a clear space equal to the length of the chamber at the end to allow the removal of lamp or quartz during routine maintenance.

Control Box

The control box can be mounted either to the UV chamber or to the wall directly. If it is chamber mounted horizontally, arrange the wall brackets to be approximately central to the chamber. In all cases ensure it is positioned so that the lamp cable is not stressed.

Saphir 1 including Saphir Plus and Saphir Pro versions


- Fit the two wall-mount brackets (B) to the wall. Space apart by about $\frac{3}{4}$ of the length of the chamber, with the slots uppermost, using the correct screws for your wall type (screws not included).
- Open the worm-drive clips to their maximum and fit over the chamber. Place the chamber on the wall brackets, slip the clips into the slots on the brackets and tighten.
- For chamber mounting of the control box, loosen the worm-drive clip by the lamp holder, fit the slot in the control box foot over the drive strap and tighten.
- Secure the other end of the control box to the chamber with the third worm-drive clip.
- For remote control box mounting, mount the chamber as above. Fit the control box wall brackets through the slot in the control box feet and screw directly to the wall.

Saphir 2, 3, 4 and 7 including Saphir Plus and Saphir Pro versions

- Fit the two wall-mount brackets (B) to the wall. Space apart by about $\frac{3}{4}$ of the length of the chamber, with the slots uppermost, using the correct screws for your wall type (screws not included).
- Open the worm-drive clips to their maximum and fit over the chamber. Place the chamber on the wall brackets, slip the clips into the slots on the brackets and tighten.
- For remote control box mounting, drill four holes on a grid of 180mm x 140mm (depending on the required orientation) and fit four off no. 6 screws. Use the keyholes to mount the control box.
- Where the control box is mounted on the chamber, undo the third worm-drive clip and thread it through the two slots on the rear of the control box. Re-engage the clip around the chamber and tighten.

Saphir 10 including Saphir Plus and Saphir Pro versions

Use the pipe clips provided to secure the Saphir 10 chamber to the wall. Fit the control box as described above, for types 2, 3, 4 and 7.



Installation must be carried out prior to making any electrical connections. See the general arrangement drawings, supplied at the end of this document.

INSTALLATION

Lamp Installation

The quartz sleeve is pre-installed into the Saphir reaction chamber. A lamp-locating spring is fitted inside the quartz sleeve and held in place with a closing cap. Remove the white cap and fit the lamp, being careful to only touch the caps at either end of the lamp with your fingers - avoiding the glass itself. Once the lamp is in place within the quartz, the lamp connector can then be fitted.

The lamp connector will only fit in one orientation. Once this has been connected the bayonet clamp can then be connected.

Refer to the lamp and quartz removal section (page 11) for detailed instructions on installing and removing the lamp and quartz.

STOCK CODE/ MODEL	SAPHIR 1	SAPHIR 2	SAPHIR 3	SAPHIR 4	SAPHIR 7	SAPHIR 10
Power supply VAC/ PH/ Hz*	110 - 240V, 50 - 60Hz single phase					
Current rating - amps	0.07	0.13	0.17	0.18	0.30	0.30
Fuse - 3A HBC	✓	✓	✓	✓	✓	✓

It is highly recommended that the water supply is applied to the reaction chamber before the unit is powered up. Allow two minutes of flow through the chamber, then check the system for any signs of leaks. If the installation appears leak-free then the unit can be powered up.

CONTROLS & INDICATORS

Saphir Basic

The Saphir base unit has a green 'LAMP ON' LED indicator showing the lamp status.



- It is highly recommended that the water supply is applied to the reaction chamber before the unit is powered up.
- Allow two minutes of flow through the chamber, then check the system for any signs of leaks.
- If the installation appears leak-free then the unit can be powered up.

SERVICING & MAINTENANCE

Maintenance

The lamp gradually deteriorates during use and must be changed at regular intervals. It is not possible to measure the level of UV being produced by the lamp by visual inspection. Therefore, a regular routine of lamp replacement is recommended to ensure effective performance (see specification for lamp life).

To replace the lamp:

1. Switch off electrical supply at the unit.
2. Remove the bayonet lampholder cap. Carefully, partially withdraw the lamp, still connected to the lampholder, from the chamber.
3. Whilst supporting the lamp disconnect the lampholder from the lamp and gently slide the lamp straight out of the quartz sleeve without applying any side pressure.
4. Warning - levering the lamp against the quartz will result in damage to the sleeve.
5. Reverse the above to fit new lamp.

WARNING

IMPORTANT:
Before starting any work on the system, isolate the unit from the power supply.

Lamp and Quartz Service


1. Remove/isolate the water supply to the chamber, then drain chamber of water.
2. Remove the bayonet lamp holder cap and gently extract the lamp from the chamber.
3. Once the lamp had been extracted far enough to hold the white lamp cap and lamp holder these can be separated. Hold both parts and apply a little pressure to separate.
4. The lamp can now be fully extracted, making sure to keep the lamp straight so as not to cause any damage to the quartz sleeve.
5. Next undo the quartz, using the key supplied, turn the quartz clamp anti-clockwise.
6. The quartz sleeve can now be removed and cleaned.
7. We recommend using a domestic scourer pad and warm water with 10% citric acid mix. Gentle use of the scourer pad will not cause any damage to the quartz sleeve. Only clean the outside of the quartz, as the inside is sealed in normal use.
8. Once the quartz has been cleaned it can be refitted to the chamber.
9. A new seal kit should be applied. The EPDM O-ring must be fitted first followed by the plastic shim (this may be a black or white shim).
10. Refit the quartz clamp checking for any damage. If damaged then it should be replaced.
11. Tighten by turning clockwise. The quartz clamp should be tightened to 6 newton meters. The new lamp can now be fitted.
12. The lamp holder will only fit one way round as the pins are asymmetrical.
13. Refit the lamp into the chamber, again keeping the lamp as straight as possible while inserting, to avoid damage to the quartz sleeve.
14. Once the lamp is in place, tighten the cap with the bayonet.

CLEANING

In the event that sediments build up on the surfaces of the quartz sleeve occasional cleaning will be required. This is dependent on the nature of the water supply and its pre-treatment; therefore, no firm guidelines can be given on how regular this will be needed. Less sediment may be experienced when the unit is vertical. The unit should be inspected after a few months use to give an indication to the amount of cleaning necessary. Where possible look into the unit using a torch once the lamp has been removed. Where this is not possible the quartz sleeve will need to be removed as follows:

- Turn off the power and remove the lamp as above
- Turn off the water supply, isolate the input and output and drain the unit
- Unscrew end seal; remove the shim and O-ring seal. Remove the quartz tube. Note: Care must be taken when removing quartz tube, as it is not supported inside the chamber. To avoid breakage, it must be kept parallel with the axis of the unit when being changed
- Clean the outside of the sleeves using a mild abrasive such as wire wool or domestic scourer - a 10% solution of citric acid will help remove any hard deposits. Vigorous scrubbing will remove scale but will not scratch the quartz sleeve. When the quartz is clean, the friction experienced when cleaning the sleeve will be dramatically reduced. Do not use an industrial scourer, as these grades may be impregnated with abrasives which may damage the sleeve surface

- Do not attempt to clean the inside of the quartz sleeve – they are sealed in normal use and this is unnecessary
- Replace the O-ring, the shim washer, and tighten the seal with firm hand pressure and another quarter turn
- Dry the unit. Turn on the water and check for leaks
- Replace the lamp and switch on



WARRANTY

12-month warranty for Water Disinfection Unit:

Daro UV Systems provides a twelve (12) month warranty from the date of purchase for this ultraviolet water disinfection unit, provided that it is installed and maintained in accordance with the manufacturer's instructions. Faults regarding the material and workmanship of this unit will be repaired or replaced free of charge.

Warranty Terms


This warranty will become void if the unit(s) are not installed and operated according to the instructions in the manual. It will not be valid for damage(s) which has (have) been caused by misuse, accidents, negligence, frost, fire, flood, or force majeure. This warranty will not be applicable to parts from which the label with the original manufacturing date code has been removed or made illegible. This warranty will only be valid if approved Daro UV Systems spare parts are used. All models are to be operated and maintained in accordance with the owner's operating instructions. This warranty will become void if the ultraviolet system is removed from its original place of installation, or if the operating pressure exceeds 10 bar, or if the temperature of the fed water exceeds 25 °C or falls below freezing point.


All faulty parts must be returned to Daro UV Systems for inspection and repair or replacement. Daro UV Systems will check and test the faulty parts and identify the reason for the defect. Faulty parts will be replaced free of charge. Daro UV Systems will not be liable for any labour costs but only for repairs which have been carried out according to the works standards. Collateral or consequential damage(s) will not be covered by this warranty. All complaints should be notified in writing to Daro UV Systems within thirty (30) days from identifying any damage. The receipt of the plant must be presented to ensure the validity of this warranty.


Please contact our friendly sales team for advice and any queries on either :
+44(0)1787 370187
or
info@darouv.co.uk


SPARES

	SAPHIR 1	SAPHIR 2	SAPHIR 3	SAPHIR 4	SAPHIR 7	SAPHIR 10
Lamps						
GER15SE	✓					
GER25SE		✓				
GER25XOSE			✓			
GER36SE				✓		
GER36XOSE					✓	✓
Quartz Sleeve & Accessories						
QTZ15SE	✓					
QTZ25SE		✓	✓			
QTZ36SE				✓	✓	✓
USK 15/25/36 Seal Kit	✓	✓	✓	✓	✓	✓
Misc Parts & Accessories						
	Part Code					
Replacement Quartz Clamp	PLA 152					
Quartz Clamp Key	ACC 504					
Replacement Lamp Holder	LHRSAPHIR					
[Pro Only] VFC Free End Connector	CON 516					
[Pro Only] Thermal Sensor / Valve Connector	THERMZ 005					
[Pro Only] UV Sensor	UVM 050					

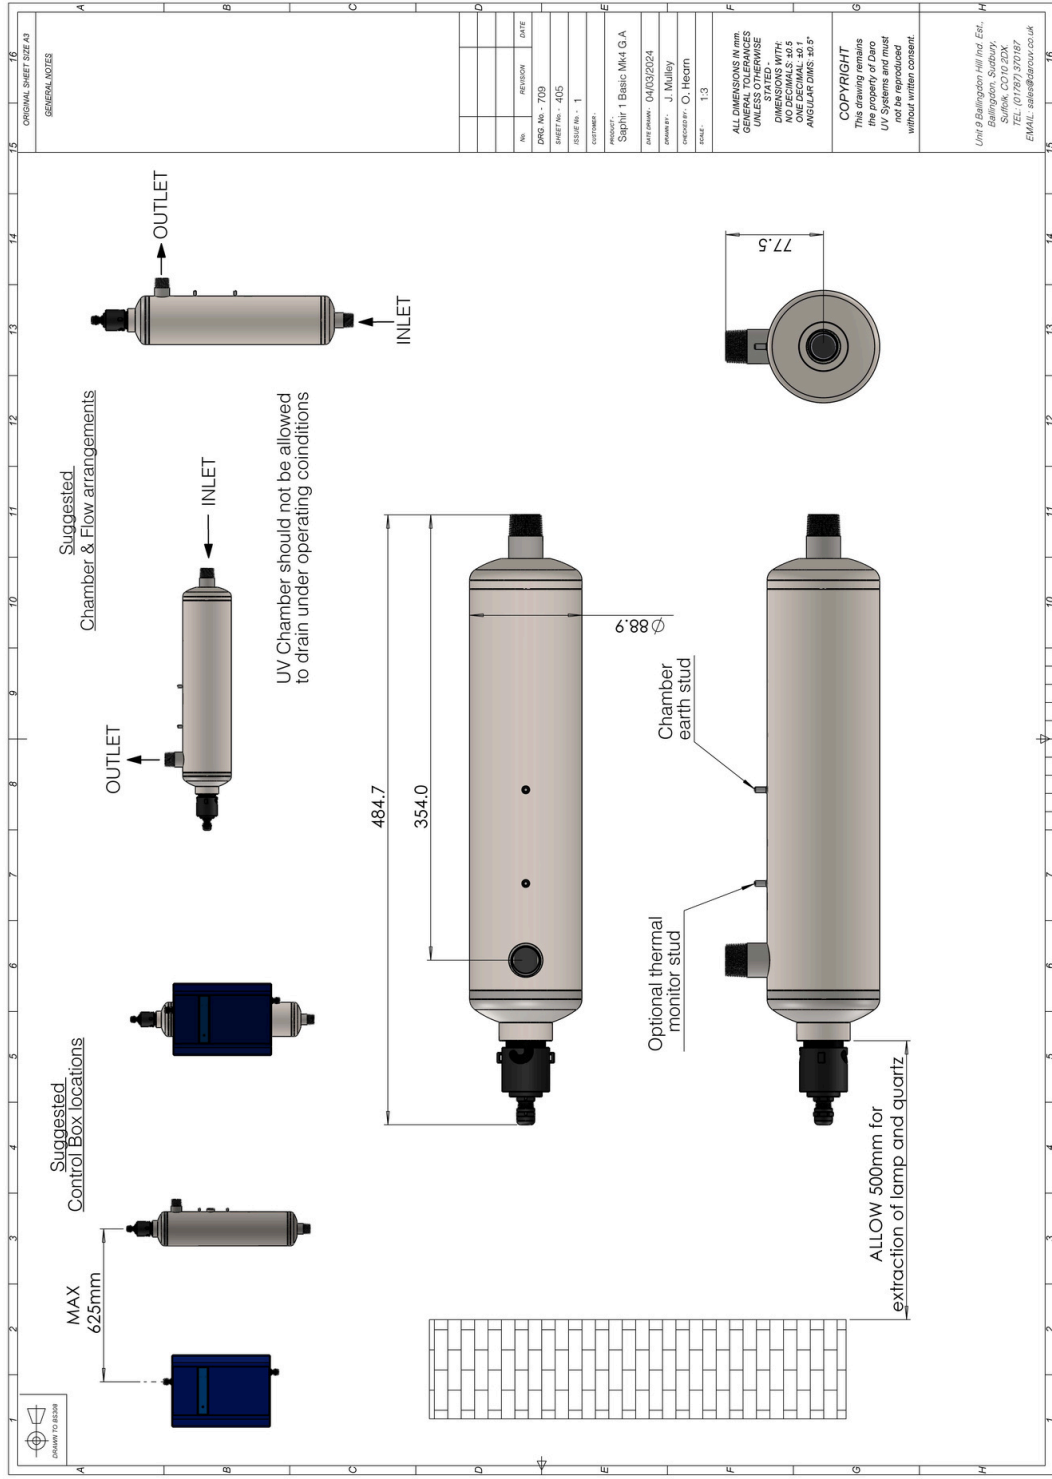

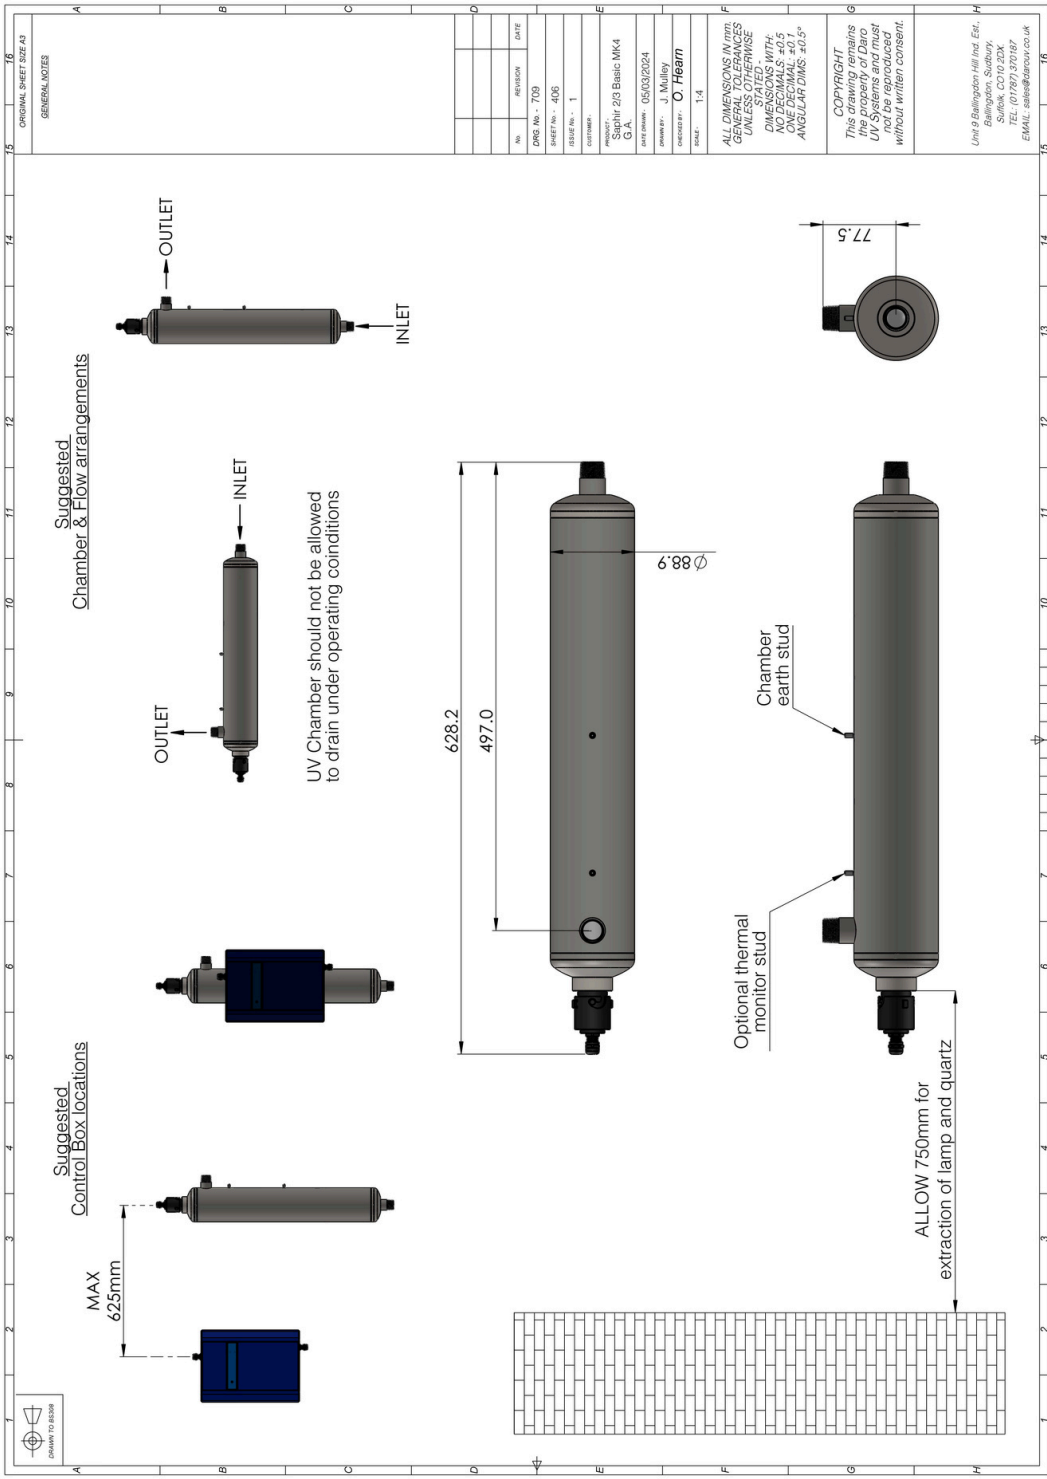

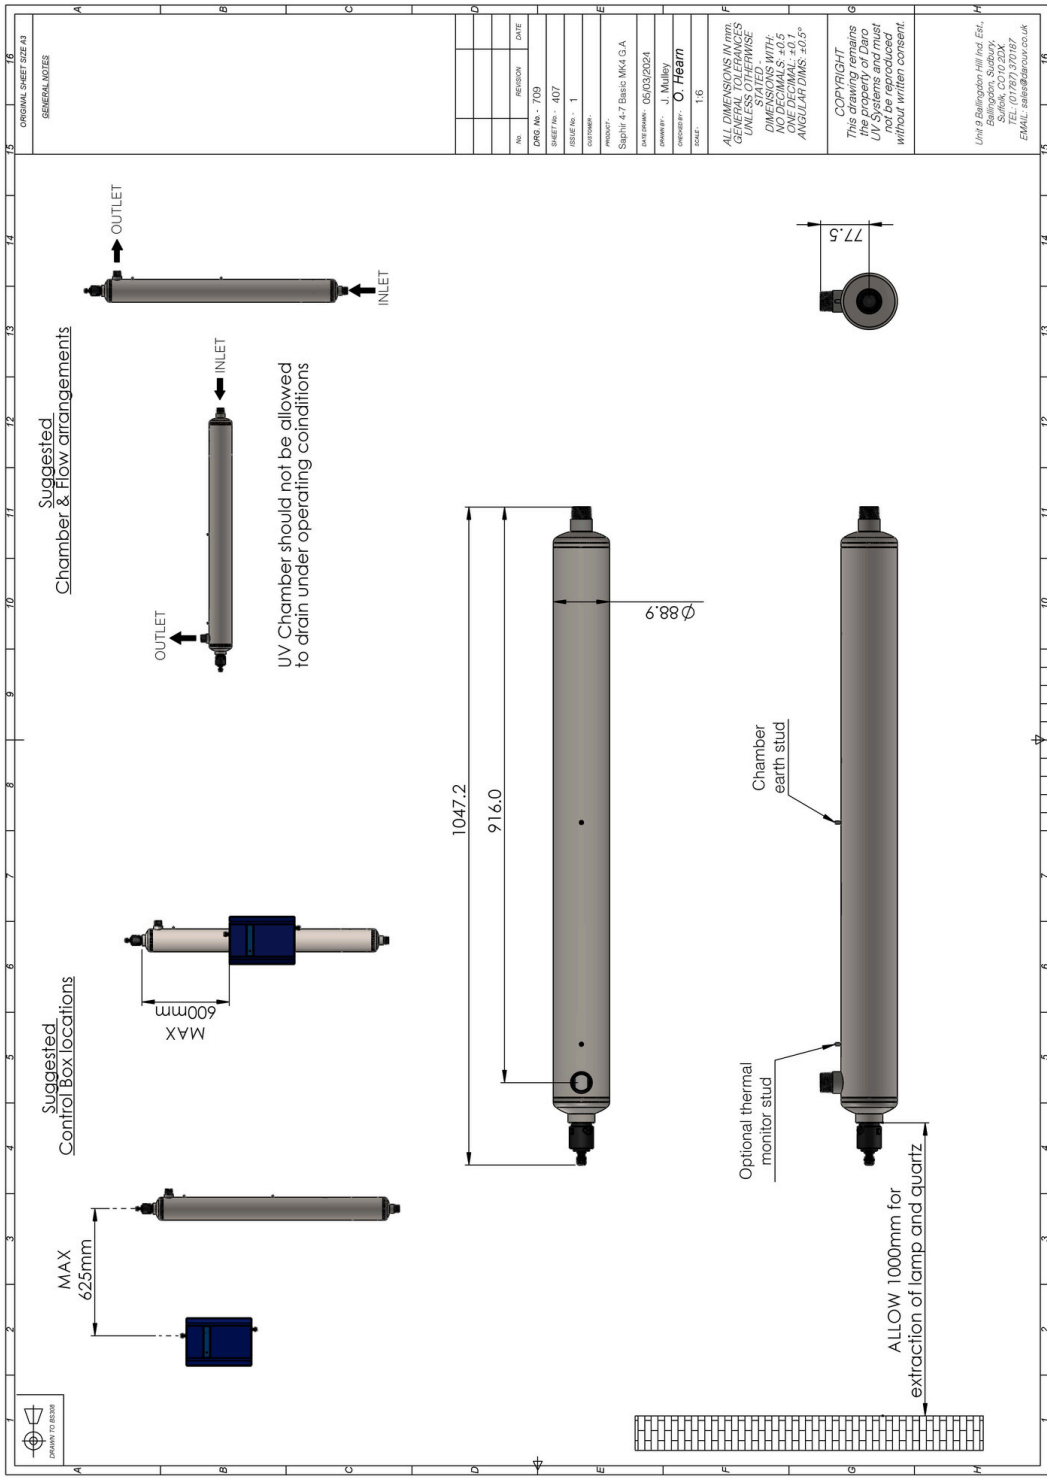

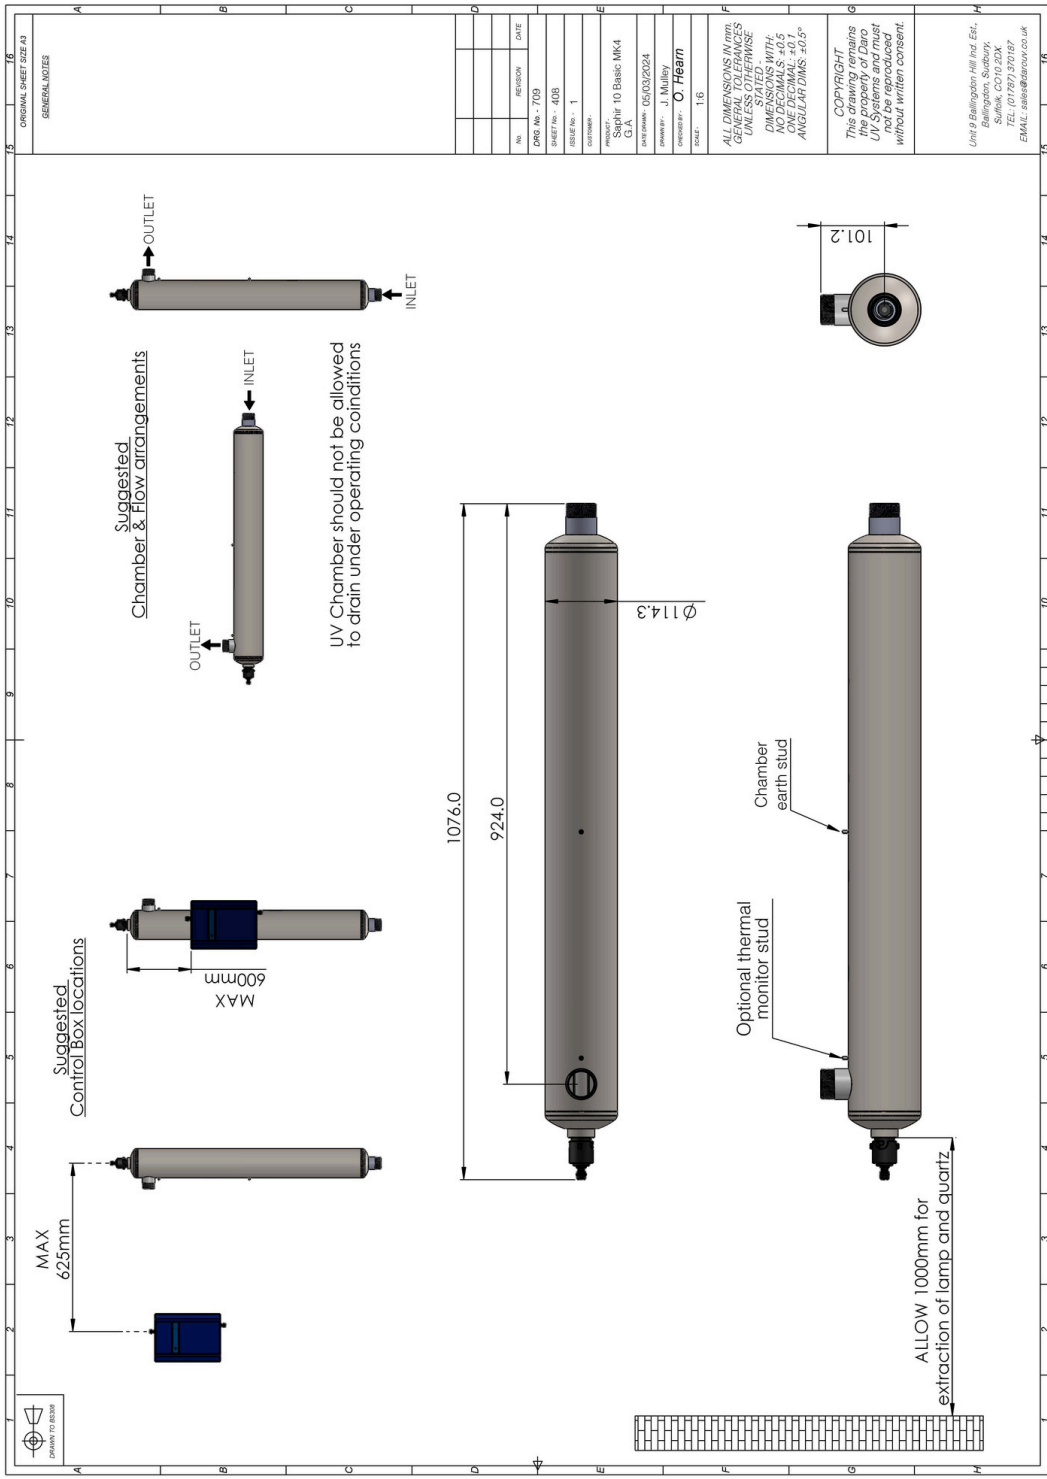





+44 (0)1787 370187
info@darouv.co.uk
darouv.co.uk

Unit 9 Ballingdon Hill Ind. Est.
Sudbury Suffolk CO10 2DX

Systems designed and manufactured by Daro UV in the
UK, other requirements considered. Daro UV is a
company registered in England & Wales.
Registration Number: 06070435.